

4 MONUMENT SIGN SECTION

SCALE: 1/2"=1'-0"

FOUNDATION GENERAL NOTES

1. CONCRETE:

NOTES:

TYPE 1 FIELD BRICK - AS

SELECTED BY ARCHITECT (MATCH

BRICK COLOR ON REDWINE SIGN)

TYPE 2 BRICK - AS SELECTED

BRICK COLOR ON REDWINE SIGN)

CAST STONE - TO MATCH CAST

BY ARCHITECT (MATCH

STONE ON REDWINE SIGN

A. ALL CONCRETE SHALL DEVELOP 3000 PSI COMPRESSIVE STRENGTH IN 28 DAYS.

CONSTRUCT ALL REINFORCED CONCRETE TO COMPLY WITH THE RECOMENDATIONS OF

ACI — 301, 305, 306, 308, 315, AND 318, LATEST EDITIONS, UNLESS NOTED OTHERWISE.

B. ALL REINFORCING SHALL CONFORM TO ASTM A615, GRADE 60.

C. NO SPLICES OF REINFORCEMENT SHALL BE MADE EXCEPT AS NOTED.

D. PROVIDE ALL ACCESSORIES NECESSARY TO SUPPORT REINFORCING AT POSITIONS SHOWN ON THE DRAWINGS.


E. DETAIL BARS IN ACCORDANCE WITH A.C.I. DETAILING MANUAL AND A.C.I.

BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE, LATEST ED.

F. LAP SLAB REINFORCING BARS A MINIMUM OF 12".

FOUNDATIONS:

A. ALLOWABLE BEARING PRESSURE = 1,500 PSF
 B. PROVIDE SITE GRADING TO CHANNEL SURFACE WATER AWAY FROM BUILDING FOUNDATION.

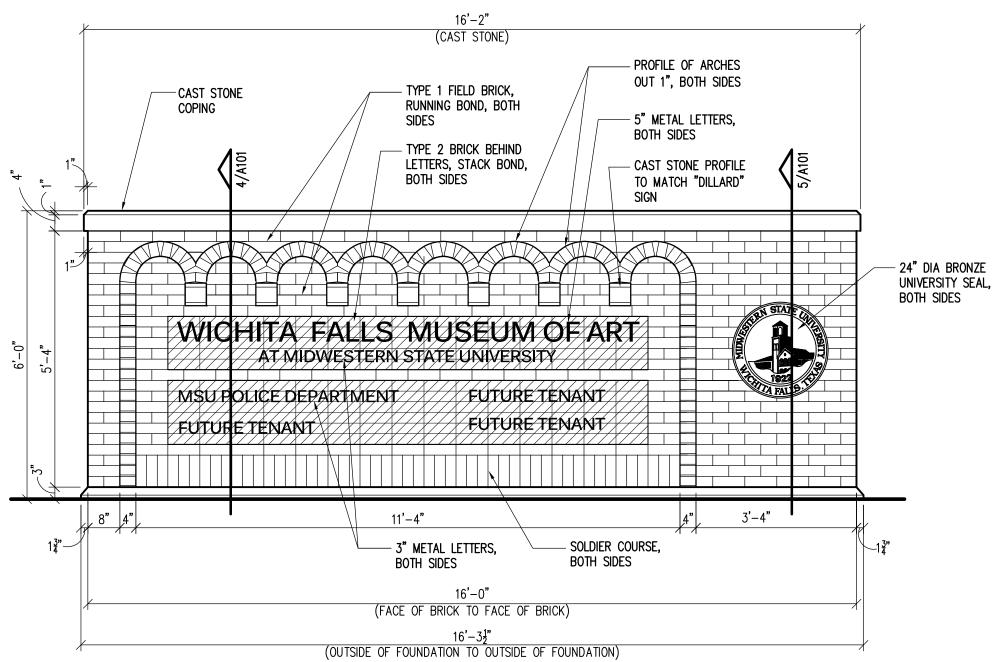

7 MONUMENT SIGN ELEVATION

SCALE: 1/2"=1'-0"

0 1 2 4

5 MONUMENT SIGN SECTION
SCALE: 1/2"=1'-0"

Copyright 2019 BYSParchitect